


CONNECTICUT RELEASE REPORTING REGULATIONS – REPORTABLE QUANTITIES

Rev. 7/21/2022

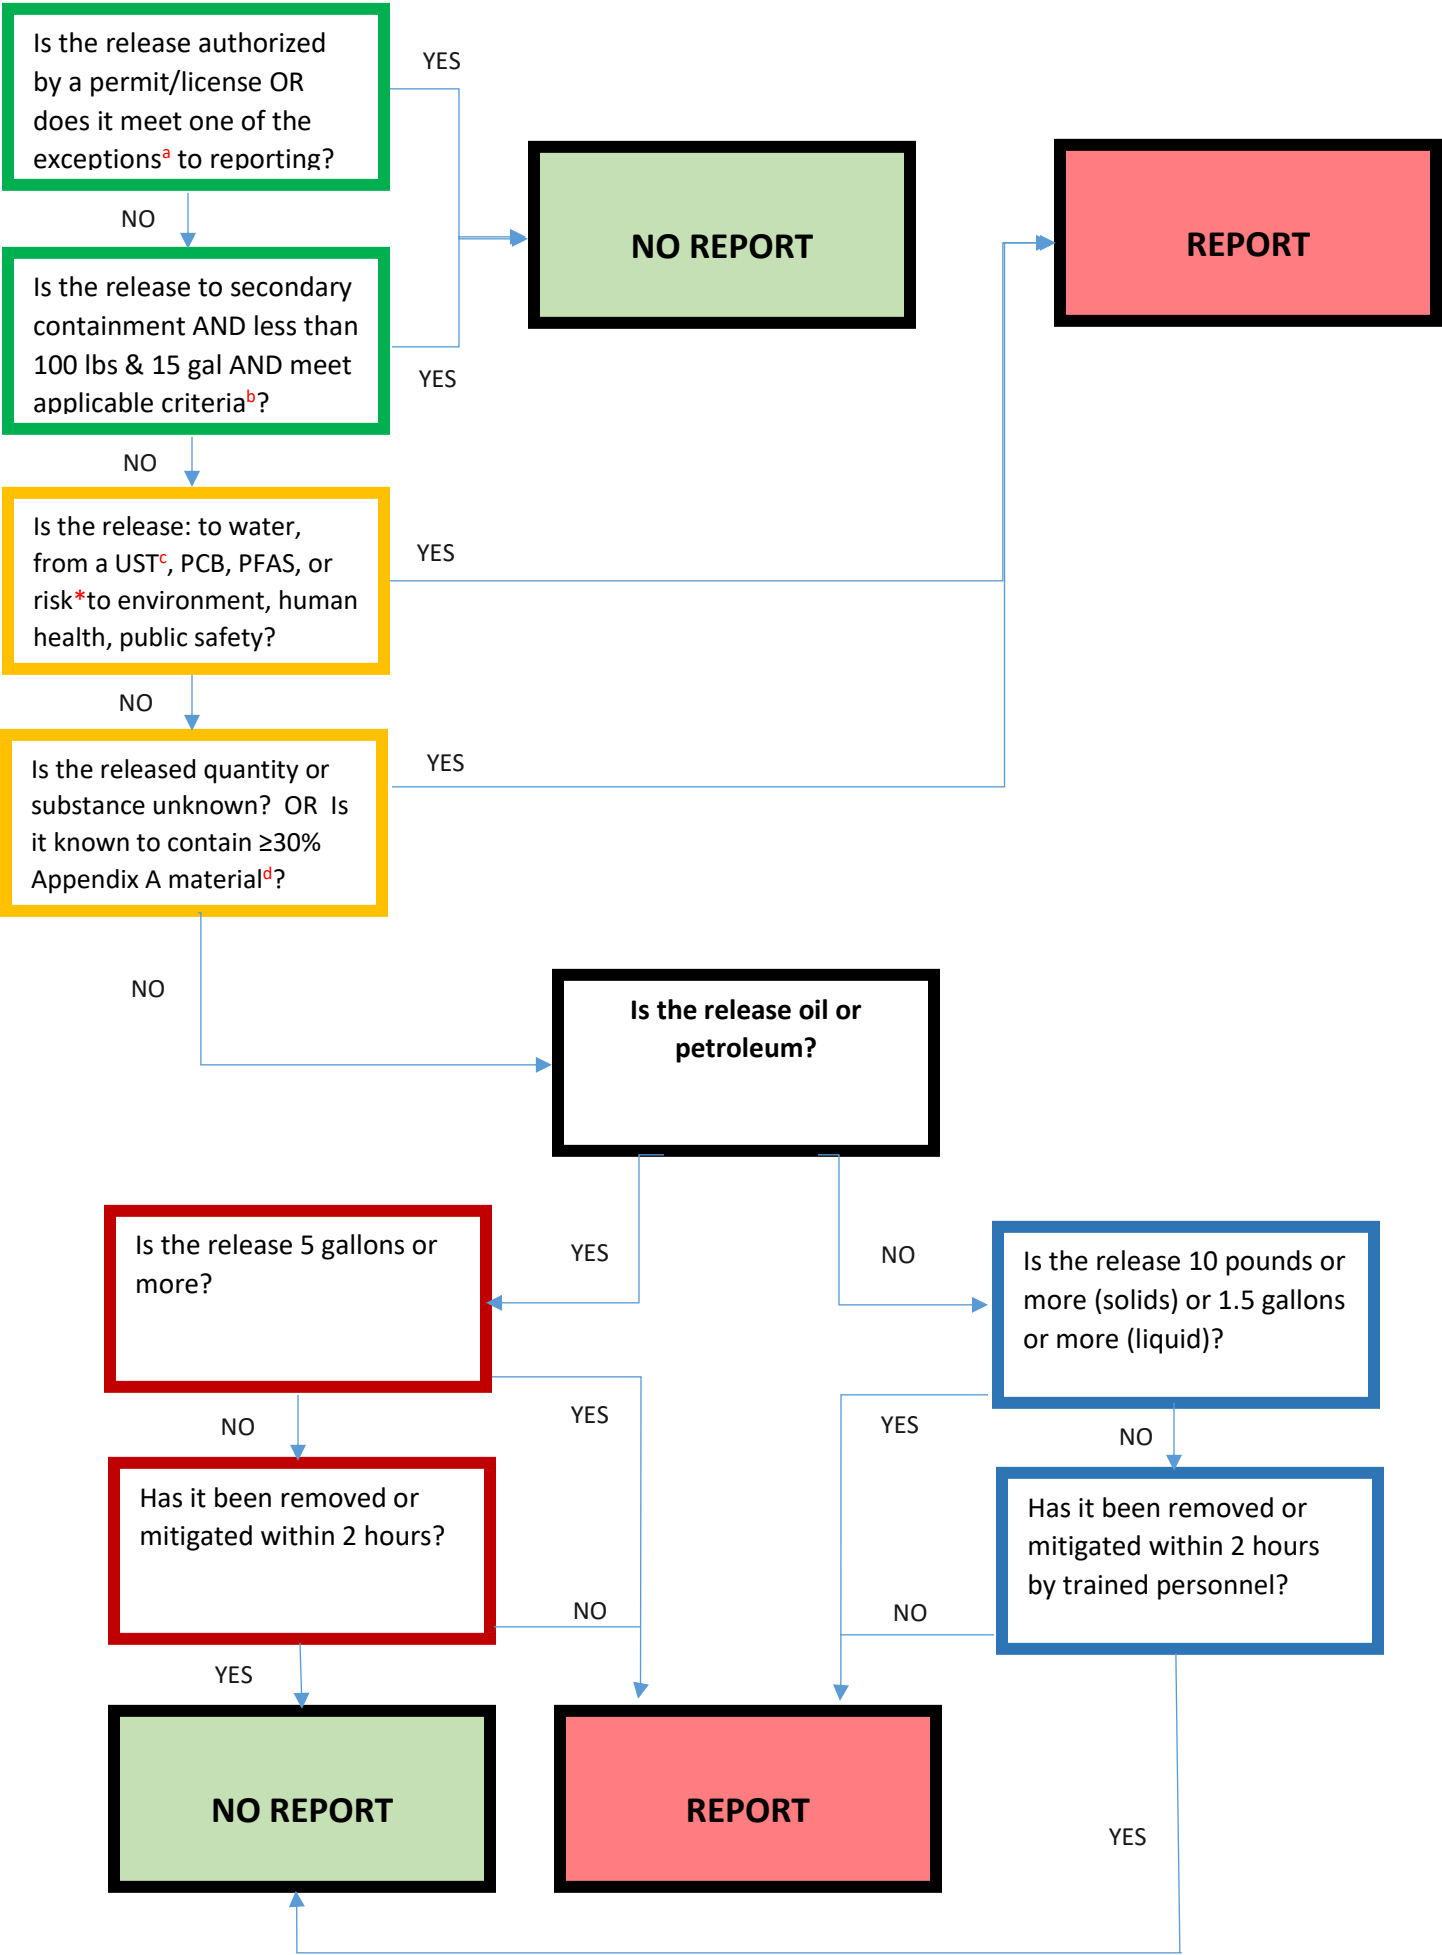

Footnotes

- ^aExceptions – Allowed (regardless of exceedance or violation) by:
- 1) State or federal law;
 - 2) Judgement or order of the court;
 - 3) Contained under a laboratory fume hood;
 - 4) Minor sheen from roadway, parking lot, driveway normal vehicle use;
 - 5) Food products (if it does not pose a risk to human health or the environment);
 - 6) Domestic sewage less than 100 gallons;

^bCriteria for releases to containment, must be cleaned within 2 hours AND must NOT be:

- 1) more than 100lbs or 15gal.; 2) involve a UST or PCB; 3) create an emergency

^cUnless it is limited to drips from nozzle during dispensing;

^dUnless contained under a laboratory fume hood

KEY

- = exceptions
- = oil or petroleum
- = non-petroleum
- = always report

^{*}risk includes actual or imminent releases per 22a-450-2(c)